Rx from: SLEEP SPECIALITS / PHYSICIAN

		Code
Initial Visit	Exam/diagnosis/consultation	99245
	Panoramic x-ray & duplicate	70355
	Trial Tongue Retaining Device (TTRD)	97760
	Fitting & 2 week trial included	

DEPOSIT
TTRD Security

Discontinue Therapy
The Client cannot use an appliance

1-2 weeks

INADEQUATE FIT WITH RESULTS / POTENTIAL

EVALUATION OF PROGRESS / ADJSUTMENT — **Code** 99212
First ten minutes

ADDITIONAL EVALUATION, — **Code** 97502
per week

ADEQUATE FIT RESULTS

CONTINUE THERAPY
Potential results TMRD

TRIAL MANDIBULAR REPOSTIONING DEVICE (TMRD) — **Code** 21089
Impressions made for fitting appliance, custom construction

INSERTION / ADJUSTMENT OF TMRD
orientation, training

DISCONTINUE THERAPY
trial appliances inadequate

1-2 weeks

INADEQUATE FIT

EVALUATION OF PROGRESS /ADJUSTMENT — **Code** 99212
First 10 minutes

ADEQUATE FIT / RESULTS

CONTINUE THERAPY
adequate results TTRD

Continued on page 2
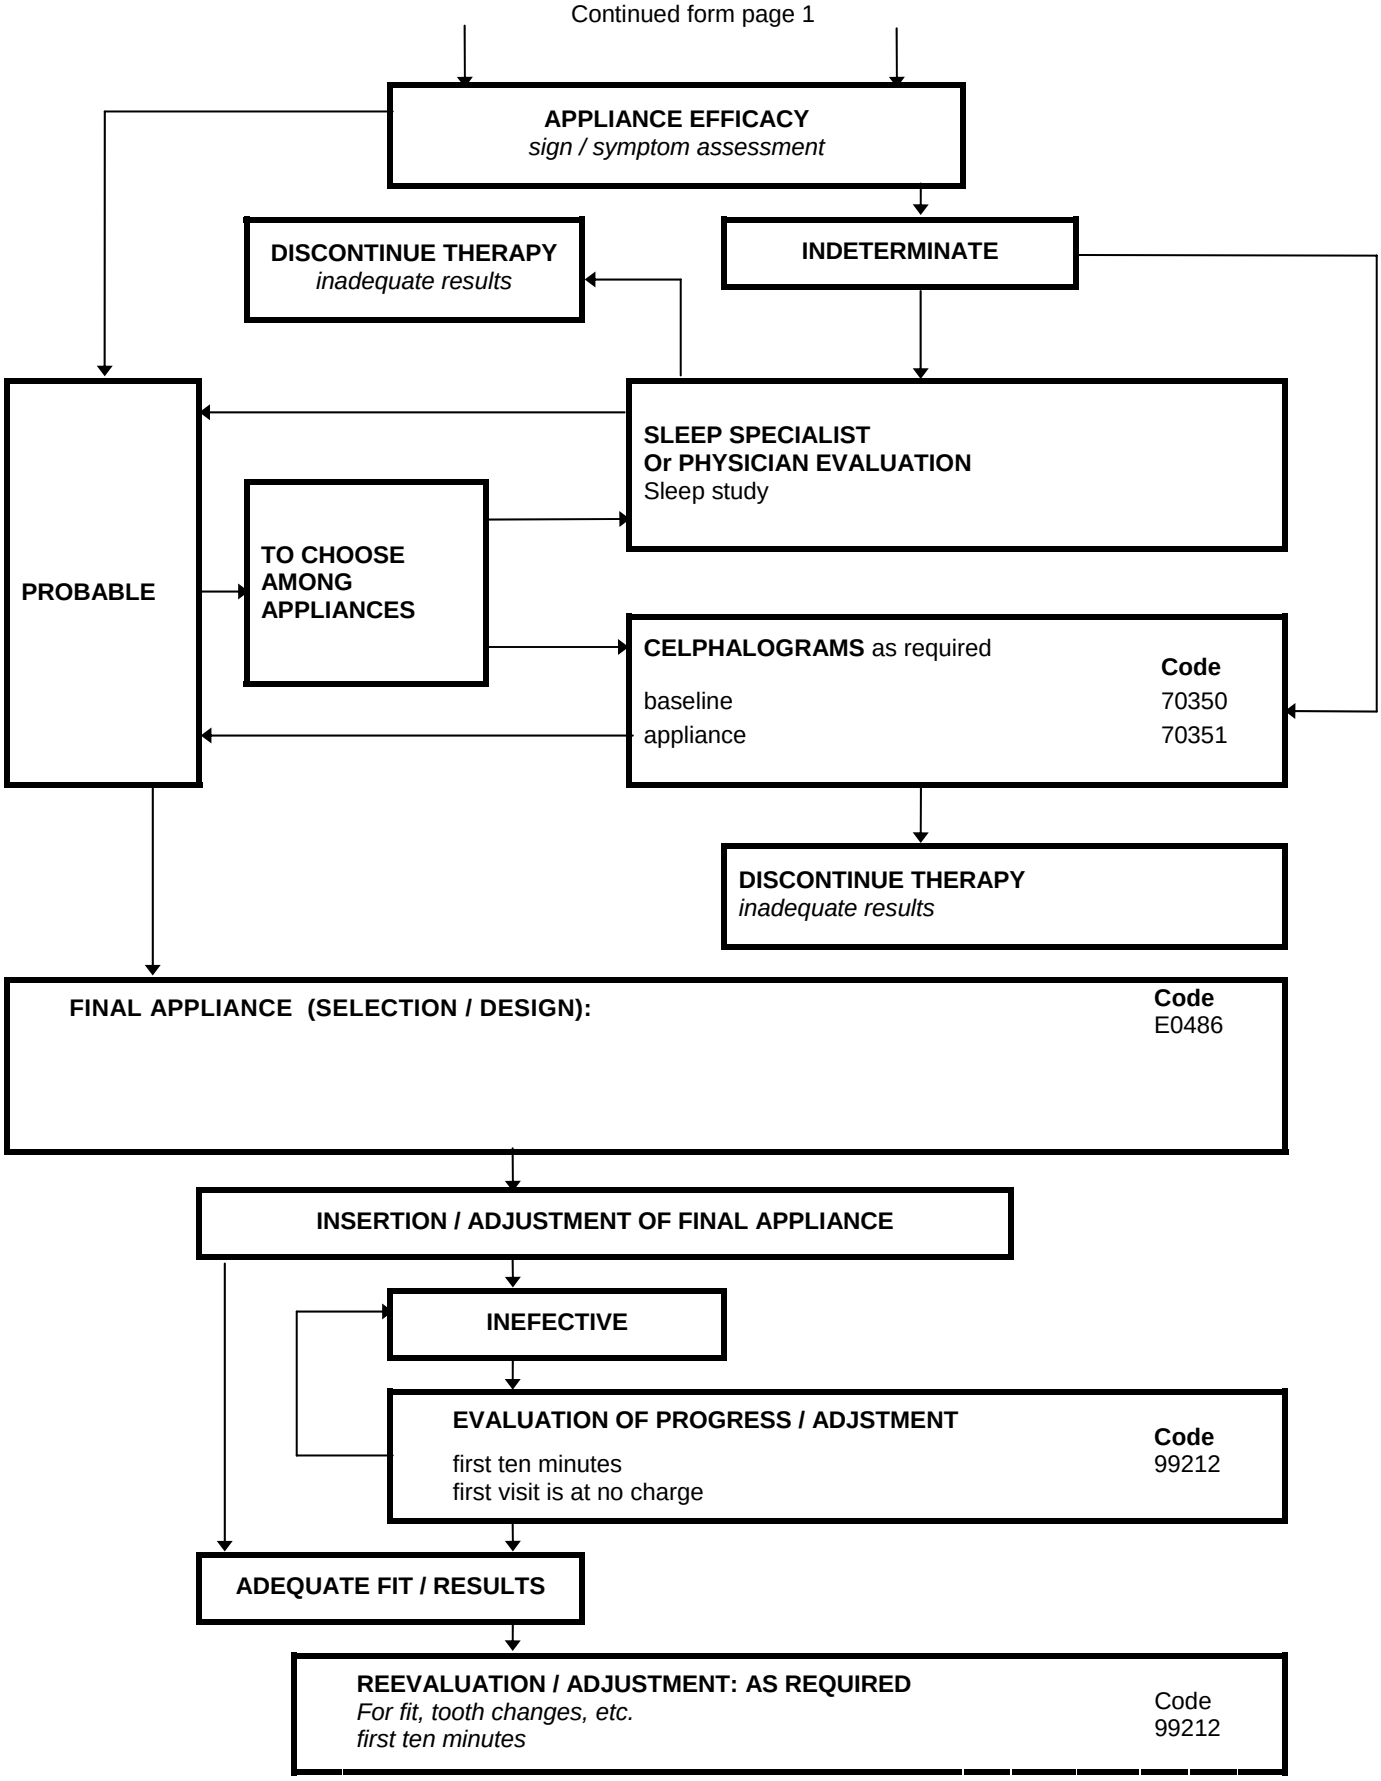
Continued form page 1